CITY OF CARMEL - WATER DISTRIBUTION DEPARTMENT

SPECIFICATIONS 11/2"- 2" OUTSIDE METER PIT SET REVISED March, 2007

- 1. METER PIT COVER. 20x36 STD METER BOX COVER. FORD # MC-36-T
- 2. COPPER SETTERS

FORD 11/2" -VBB76-18B-44-66

2" -VBB77-18B-44-77


MUELLER 11/2" -B-2423 18"


MUELLER 2" -B-2423 18"

- 3. METER PIT 36 x 36" FRATCO METER PITS. 36" LENGTH OF N-12 OR EQUAL.
- 4. SERVICE LINE. ALL 11/2" AND 2" SERVICE LINES MUST BE COPPER.
- BALL TYPE CURB STOP. MUST HAVE COMPRESSION TYPE FITTINGS ON BOTH ENDS AND BE SUPPORTED BY A CONCRETE BLOCK. Mueller- 25155-3, Ford- 11/2" B44-666 2" B44-777.
- 6. SERVICE BOX with SERVICE BOX ROD. DEPTH OF BURY WILL VARY.
- 7. CORPORATION STOP. CORPORATION STOP SHOULD BE TAPPED AT THE HORIZONAL POSITION 3 O'CLOCK. 11/2"- 2" DUCTILE IRON or PLASTIC- repair clamp with Threaded 11/2" or 2". SMITH-BLAIR # 238 FULL CIRCLE WRAP AROUND REPAIR CLAMP ALSO ROMAC OR JCM EQUAL

NOTES

- 1. Service lines require compression couplings only. NO PACK JOINTS ALLOWED
- 2. No meter pit shall be installed in a traffic area, driveway, or side walk.
- There shall be no buried joints or couplings, except for the corporation stop on the Main and the curb stop valve.
- Care should be taken when establishing final grade. The meter pit cover is
 expected to be at grade. Using bricks or blocks to raise the meter pit cover will
 not be accepted.
- Any questions should be directed to the Carmel Water Distribution Department at 733-2855

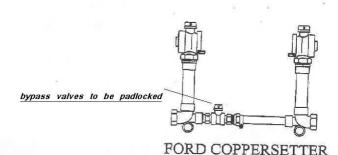



MUELLER COPPERSETTER